40" x 48" CAMBRIAN MRL
LEFT 90 DEGREE CAB

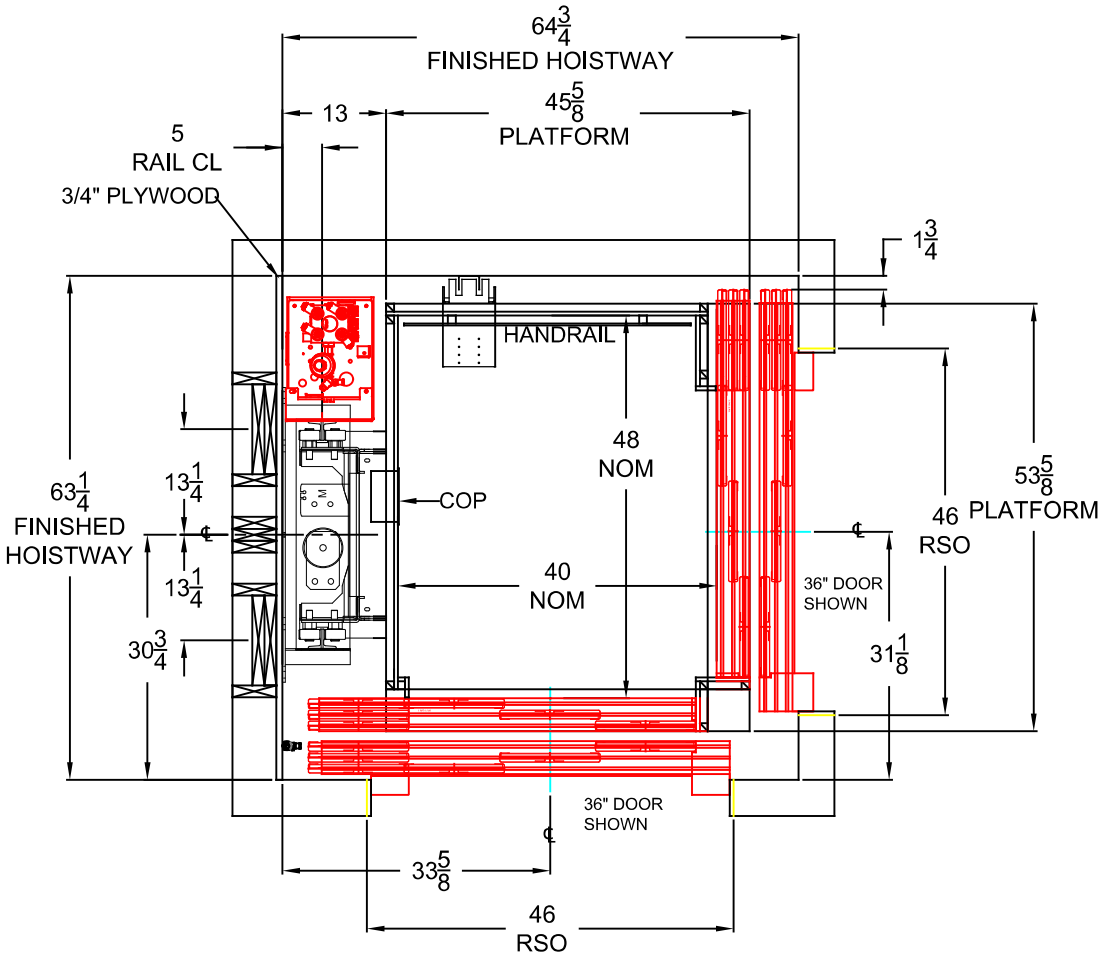

MRL REQUIREMENTS:

1. MAXIMUM 55' OF WIRE BETWEEN PUMP AND CONTROLLER
2. CONTROLLER MUST BE OUTSIDE HOISTWAY
3. REMOTE MANUAL LOWERING MUST BE ACCESIBLE FROM OUTSIDE HOISTWAY
4. A HYDRAULIC SHUT OFF MUST BE ACCESIBLE FROM OUTSIDE HOISTWAY

CAMBRIDGE ELEVATING

DRAWING NOTES

LAYOUT DRAWING FOR HOISTWAY CONSTRUCTION ONLY. FINAL CAB LAYOUT DIMENSIONS MAY VARY.

CAMBRIDGE ELEVATING DESIGNS AND MANUFACTURES THIS ELEVATOR IN ACCORDANCE WITH ASME A17.1 / CSA B44, SECTION 5.3 – PRIVATE RESIDENCE ELEVATORS. ALL DESIGN DATA, CLEARANCES, AND SAFETY PROVISIONS ARE BASED ON THIS STANDARD. INSTALLATION MUST ALSO COMPLY WITH ALL APPLICABLE LOCAL BUILDING AND ELECTRICAL CODES, WHICH MAY IMPOSE ADDITIONAL REQUIREMENTS. IT IS THE DEALER'S RESPONSIBILITY TO ENSURE SITE COMPLIANCE WITH LOCAL AUTHORITY-HAVING-JURISDICTION (AHJ) STANDARDS.